

1:1 Replacement for NFDM

Fat analysis: Medallion Labs


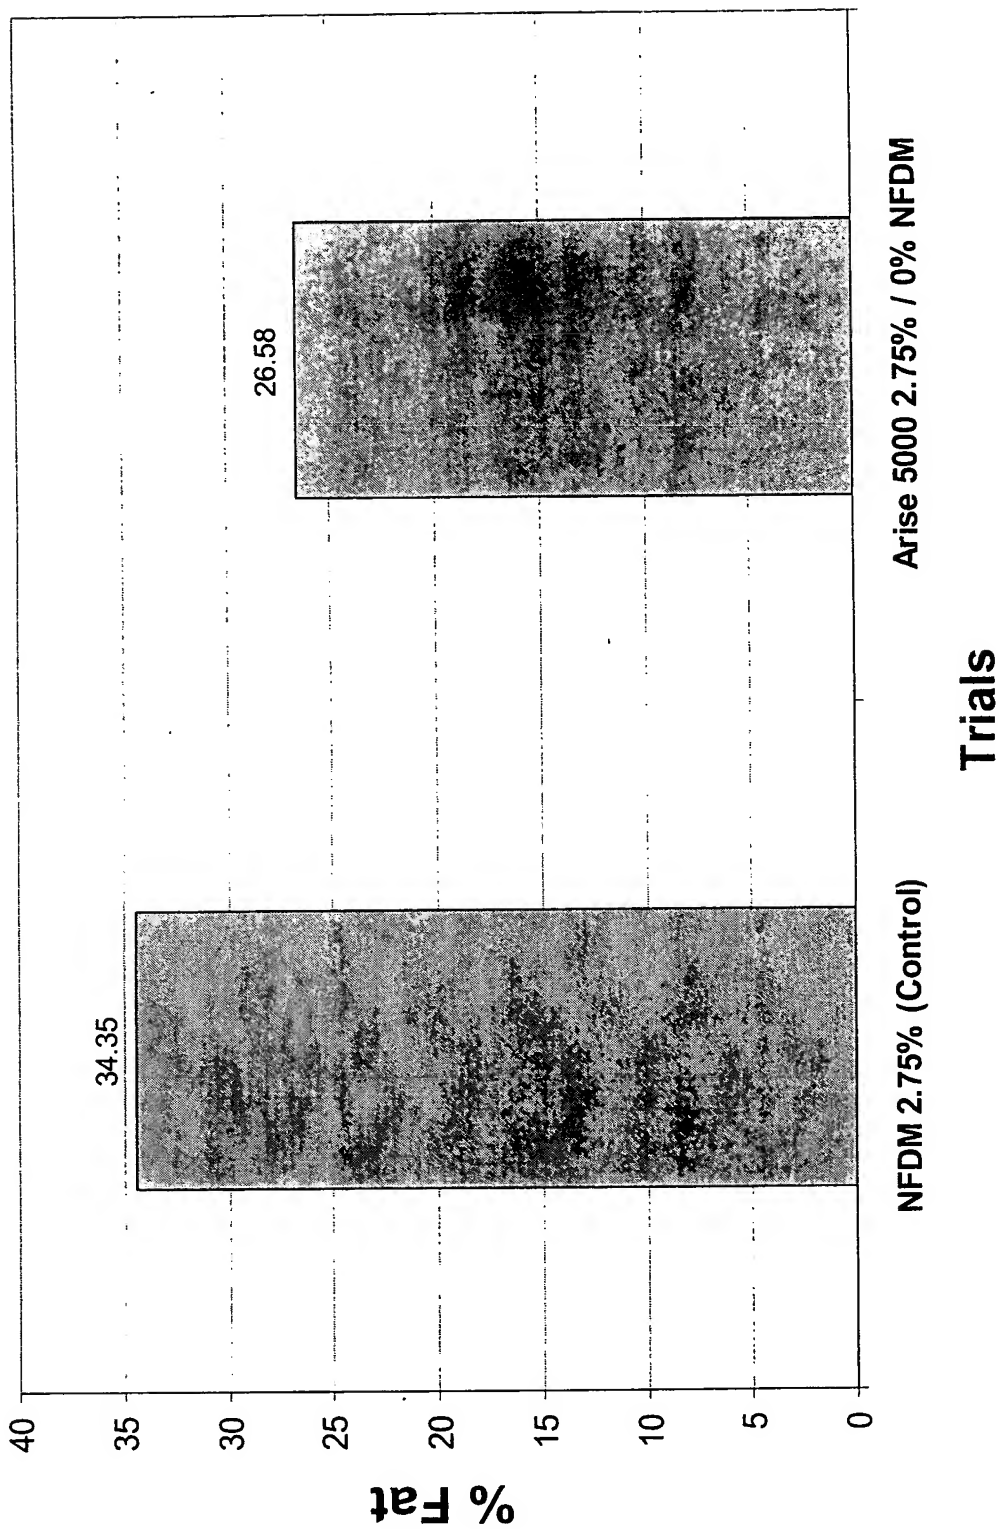


Figure 1

Control vs .67:1 Replacement for NFDM

Fat analysis by final Wt. difference

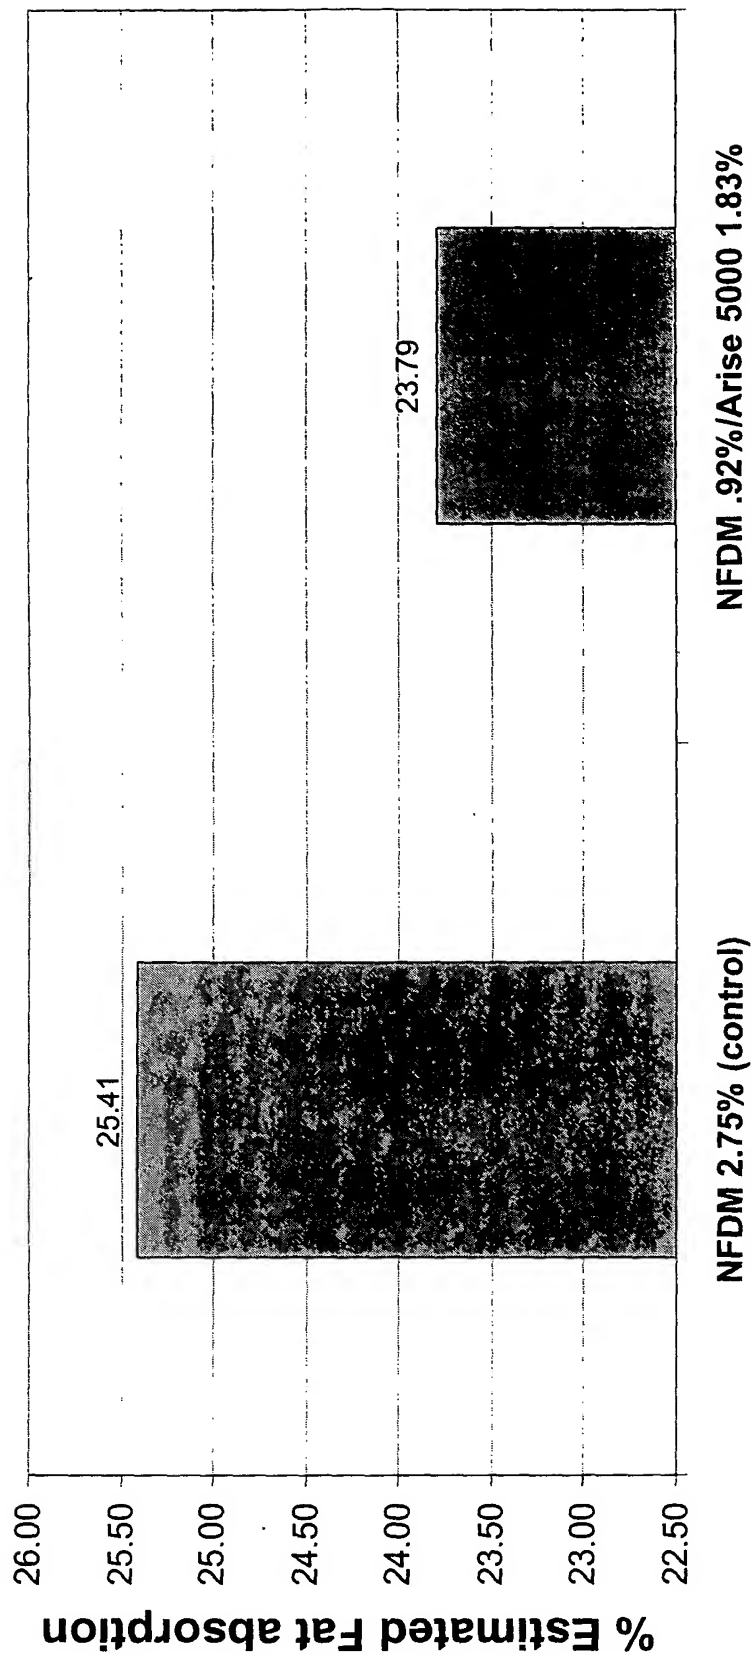


Trials

Figure 2

% Fat in Chocolate Cake Doughnut Variations

(% Fat results obtained from Medallion Labs)

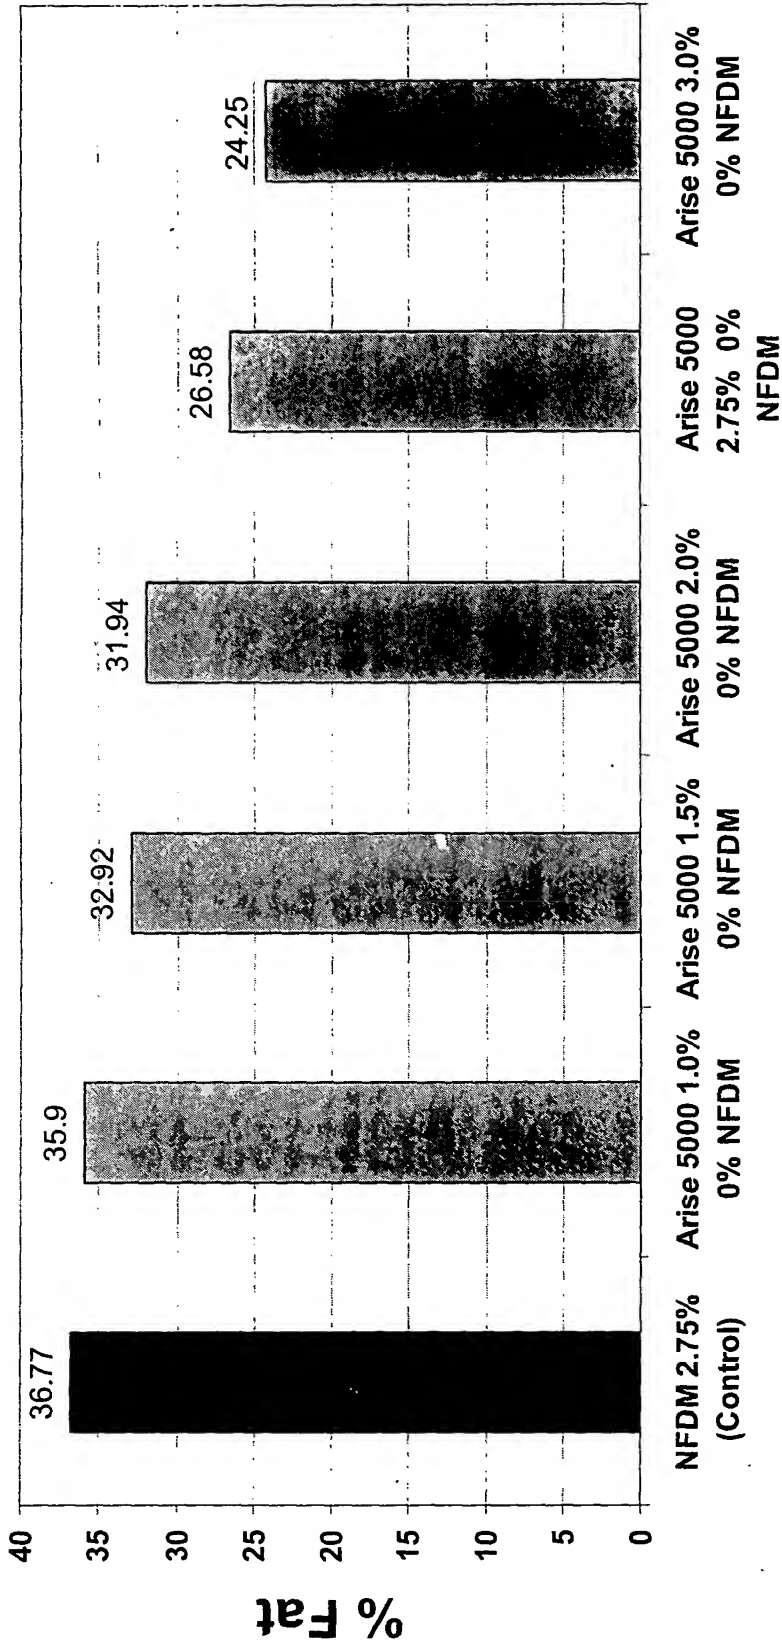

Trial

*(% fat was obtained by Acid Hydrolysis)

Figure 3